


SIEMENS


KÜHLSCHRANK KT 1434 -D1
KT 143458-F1
KT 143471-NL1
KT 150516-CH1

bis Fert.-Nr. 5709

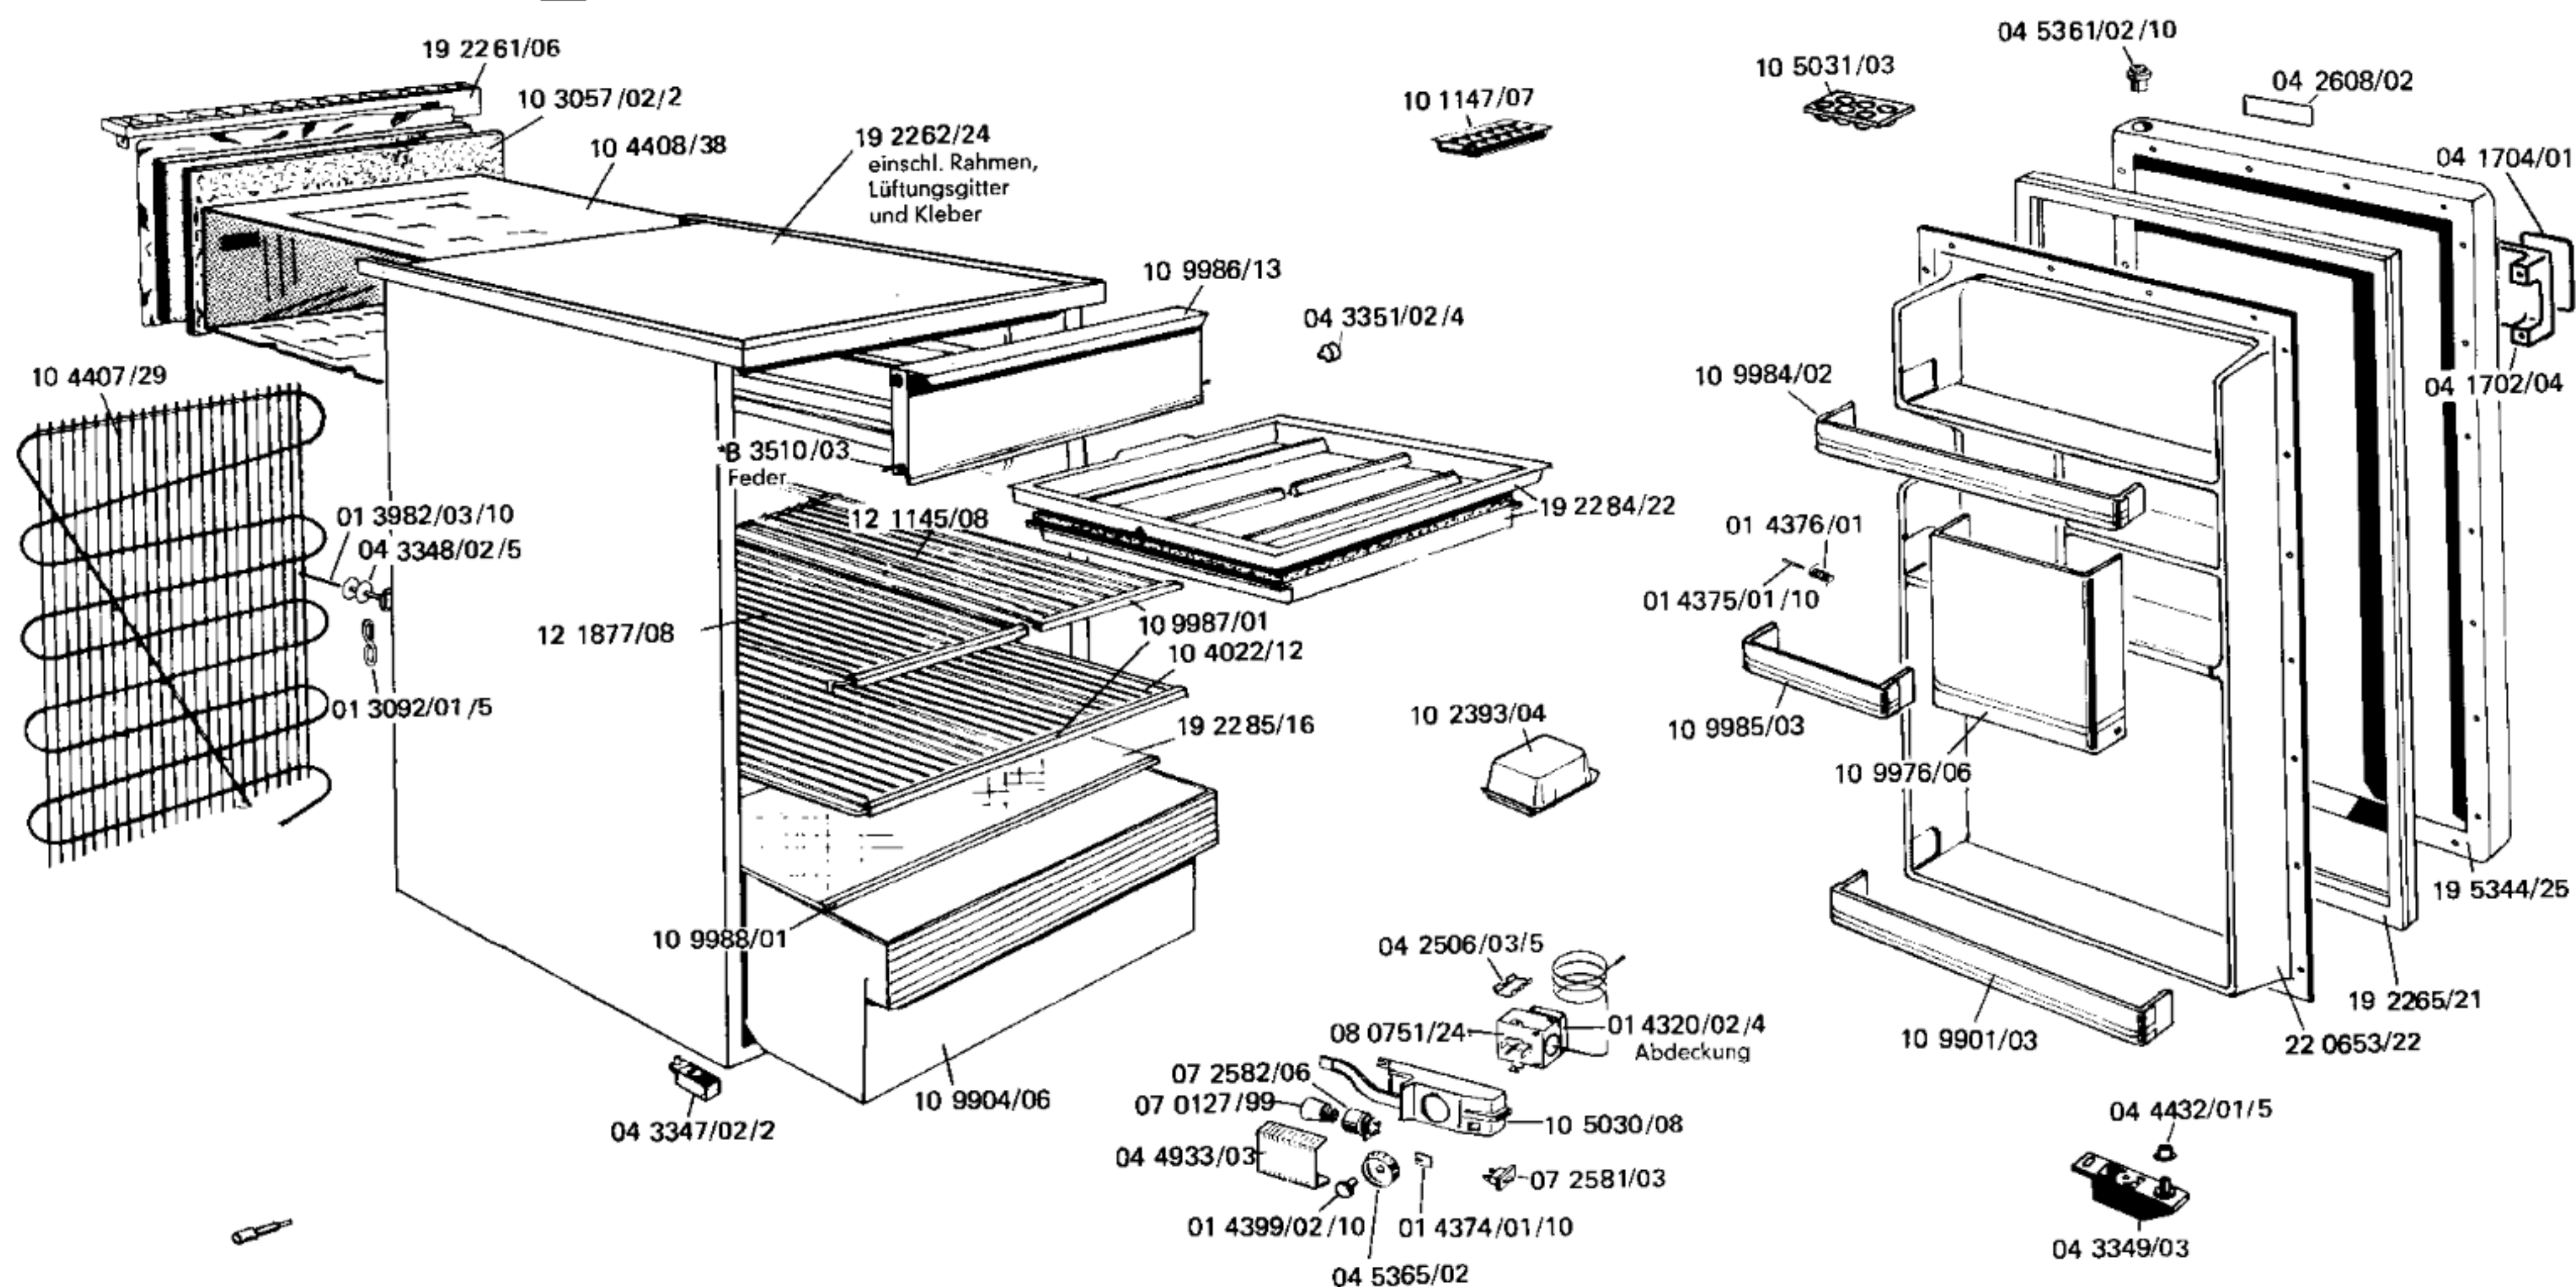

250213-2/1

*X 8614/00
Bed.-Anleitung

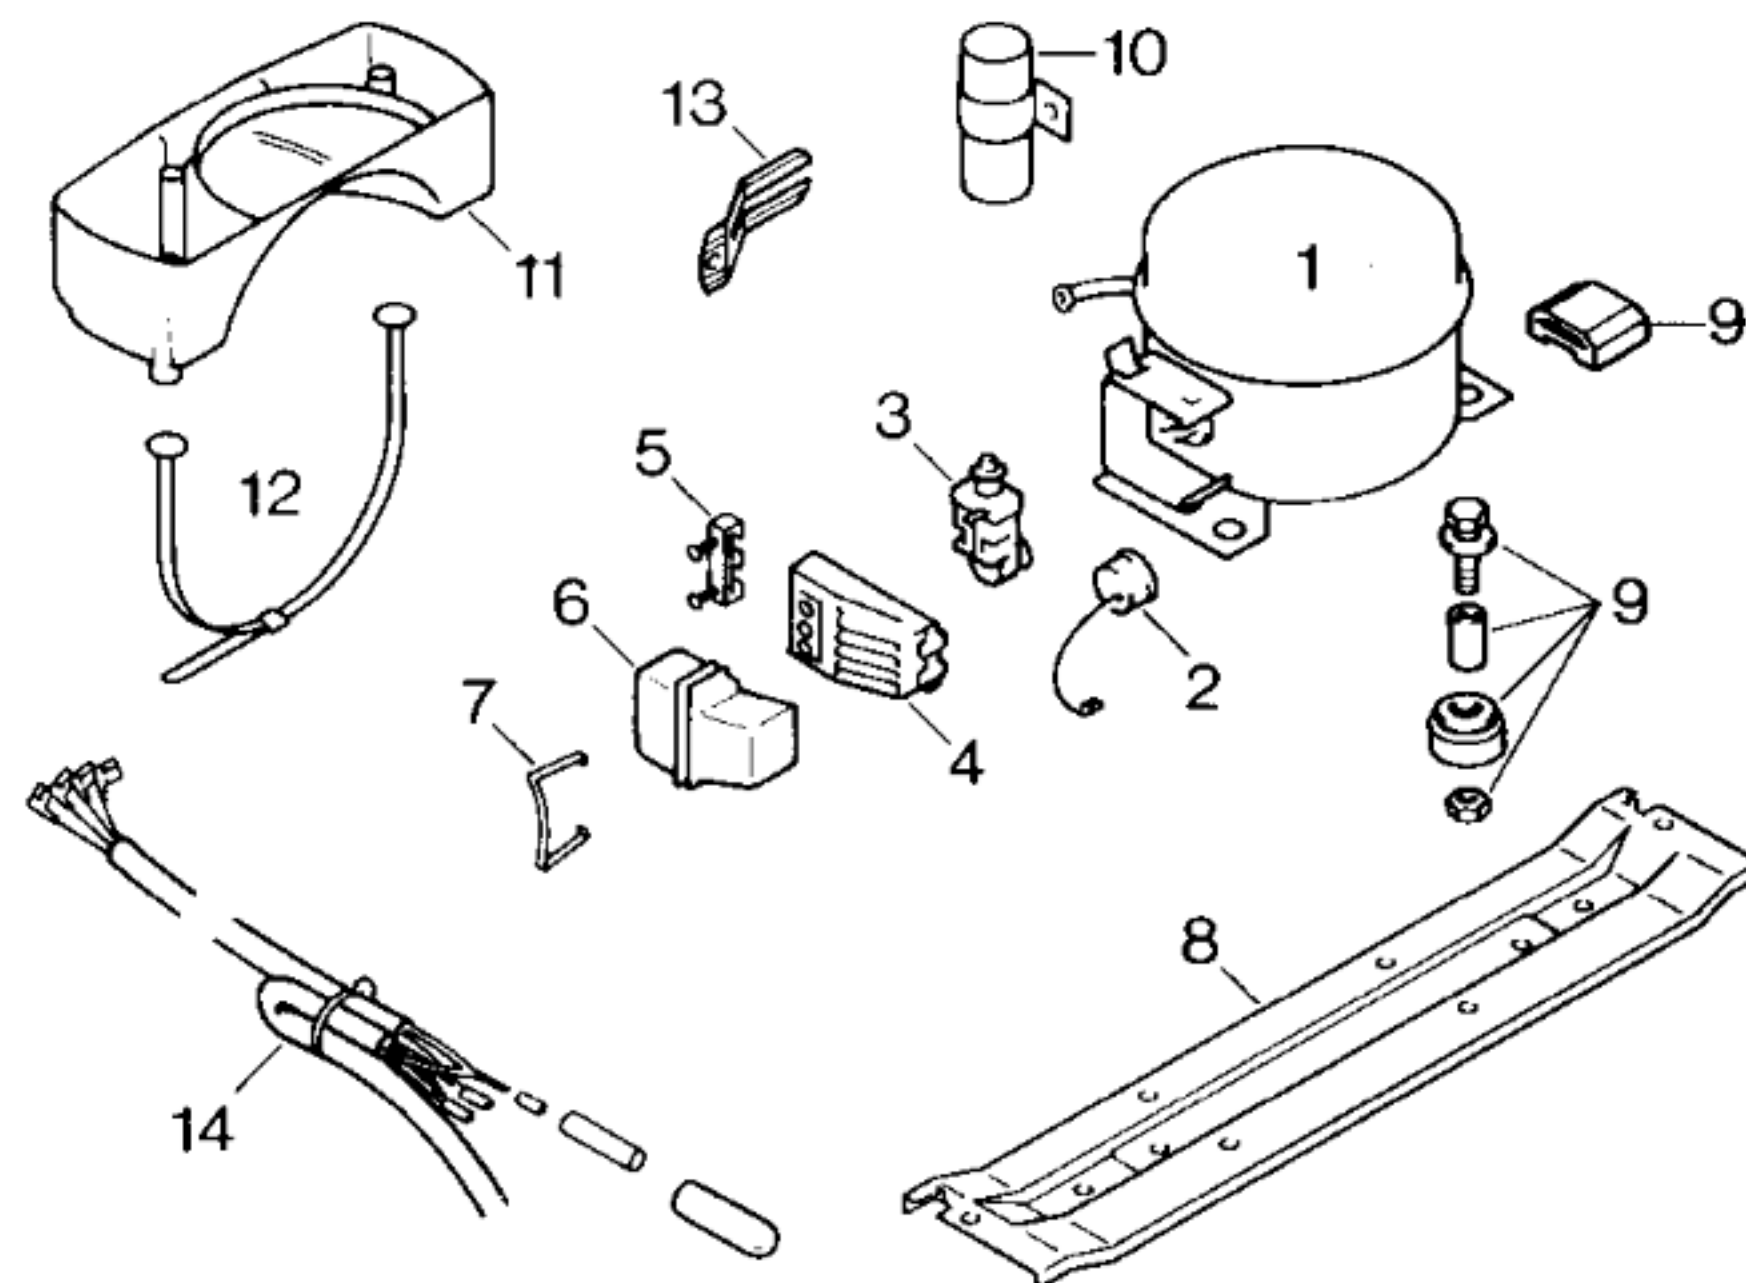

TECHNISCHE DATEN / TECHNICAL DATA / DONNEES TECHNIQUES				
Verdichter/Compressor/Compresseur	Bosch	Bosch	Danfoss	Danfoss
Typ/Type	V 612	V 792	TL 3 A	TL 4 A
Förderleistung/Delivery/Débit	612	792	576	702
Anlaufstrom/Starting current/Cour. de démarrage	5,6	7,8	7,2	7,8
Widerstand/Resistance/Résistance	31,5	23,8	31,7	23,8
Ha/main/prin.	50,5	17,0	17,0	17,0
Hi/aux				
Temp.-Regler/Thermostat	Ranco			
Typ/Type	F 50			
Reglerstellung/Position	kalt	warm		
Schaltwerte/Switching values/	- 12	- 2,5		
Valeurs de commutation	- 25	- 11,5		
(„abtauen“ od.)	„alarm“			
Füllmenge/Fill.quantity/Charge	R12	g	85	
Anschlußwert/Conn.load/Puiss. connectée	W	90	100	80
Heizung/Heater/Chauffage				
Widerstand/Resistance/Résistance	Ω			
Leistung/Power/Puissance	W			
Ventilator/Blower/Ventilateur				
Widerstand/Resistance/Résistance	Ω			
Magnetventil/Magnetic valve/Electrovanne				
Widerstand/Resistance/Résistance	Ω			
Spannung/Voltage/Tension	V			

Pos.	D1,CH1,NL1	F1	D1,CH1,NL1	F1
	Bosch	Bosch	Danfoss	Danfoss
1			14 0080/44	13 1064/45
2	07 1691/18	07 2115/18		
3	07 1692/18	07 1804/18	02 0108/27	02 0108/27
4	04 9757/02	04 9757/02		
5			02 1361/04	02 1361/04
6	04 9758/02	04 9758/02	05 1413/06	05 1413/06
7				
8			*11 2022/05	*11 2022/05
9			*05 0166/05/4	*05 0166/05/4
10				
11				
12				
13			*04 1568/01/2	*04 1568/01/2
14			*05 1226/08	*05 1226/08

*) Bei Ersatz des Bosch-Verdichters mitbestellen
To be ordered when replacing the Bosch compressor
A commander lors du remplacement du compresseur Bosch