



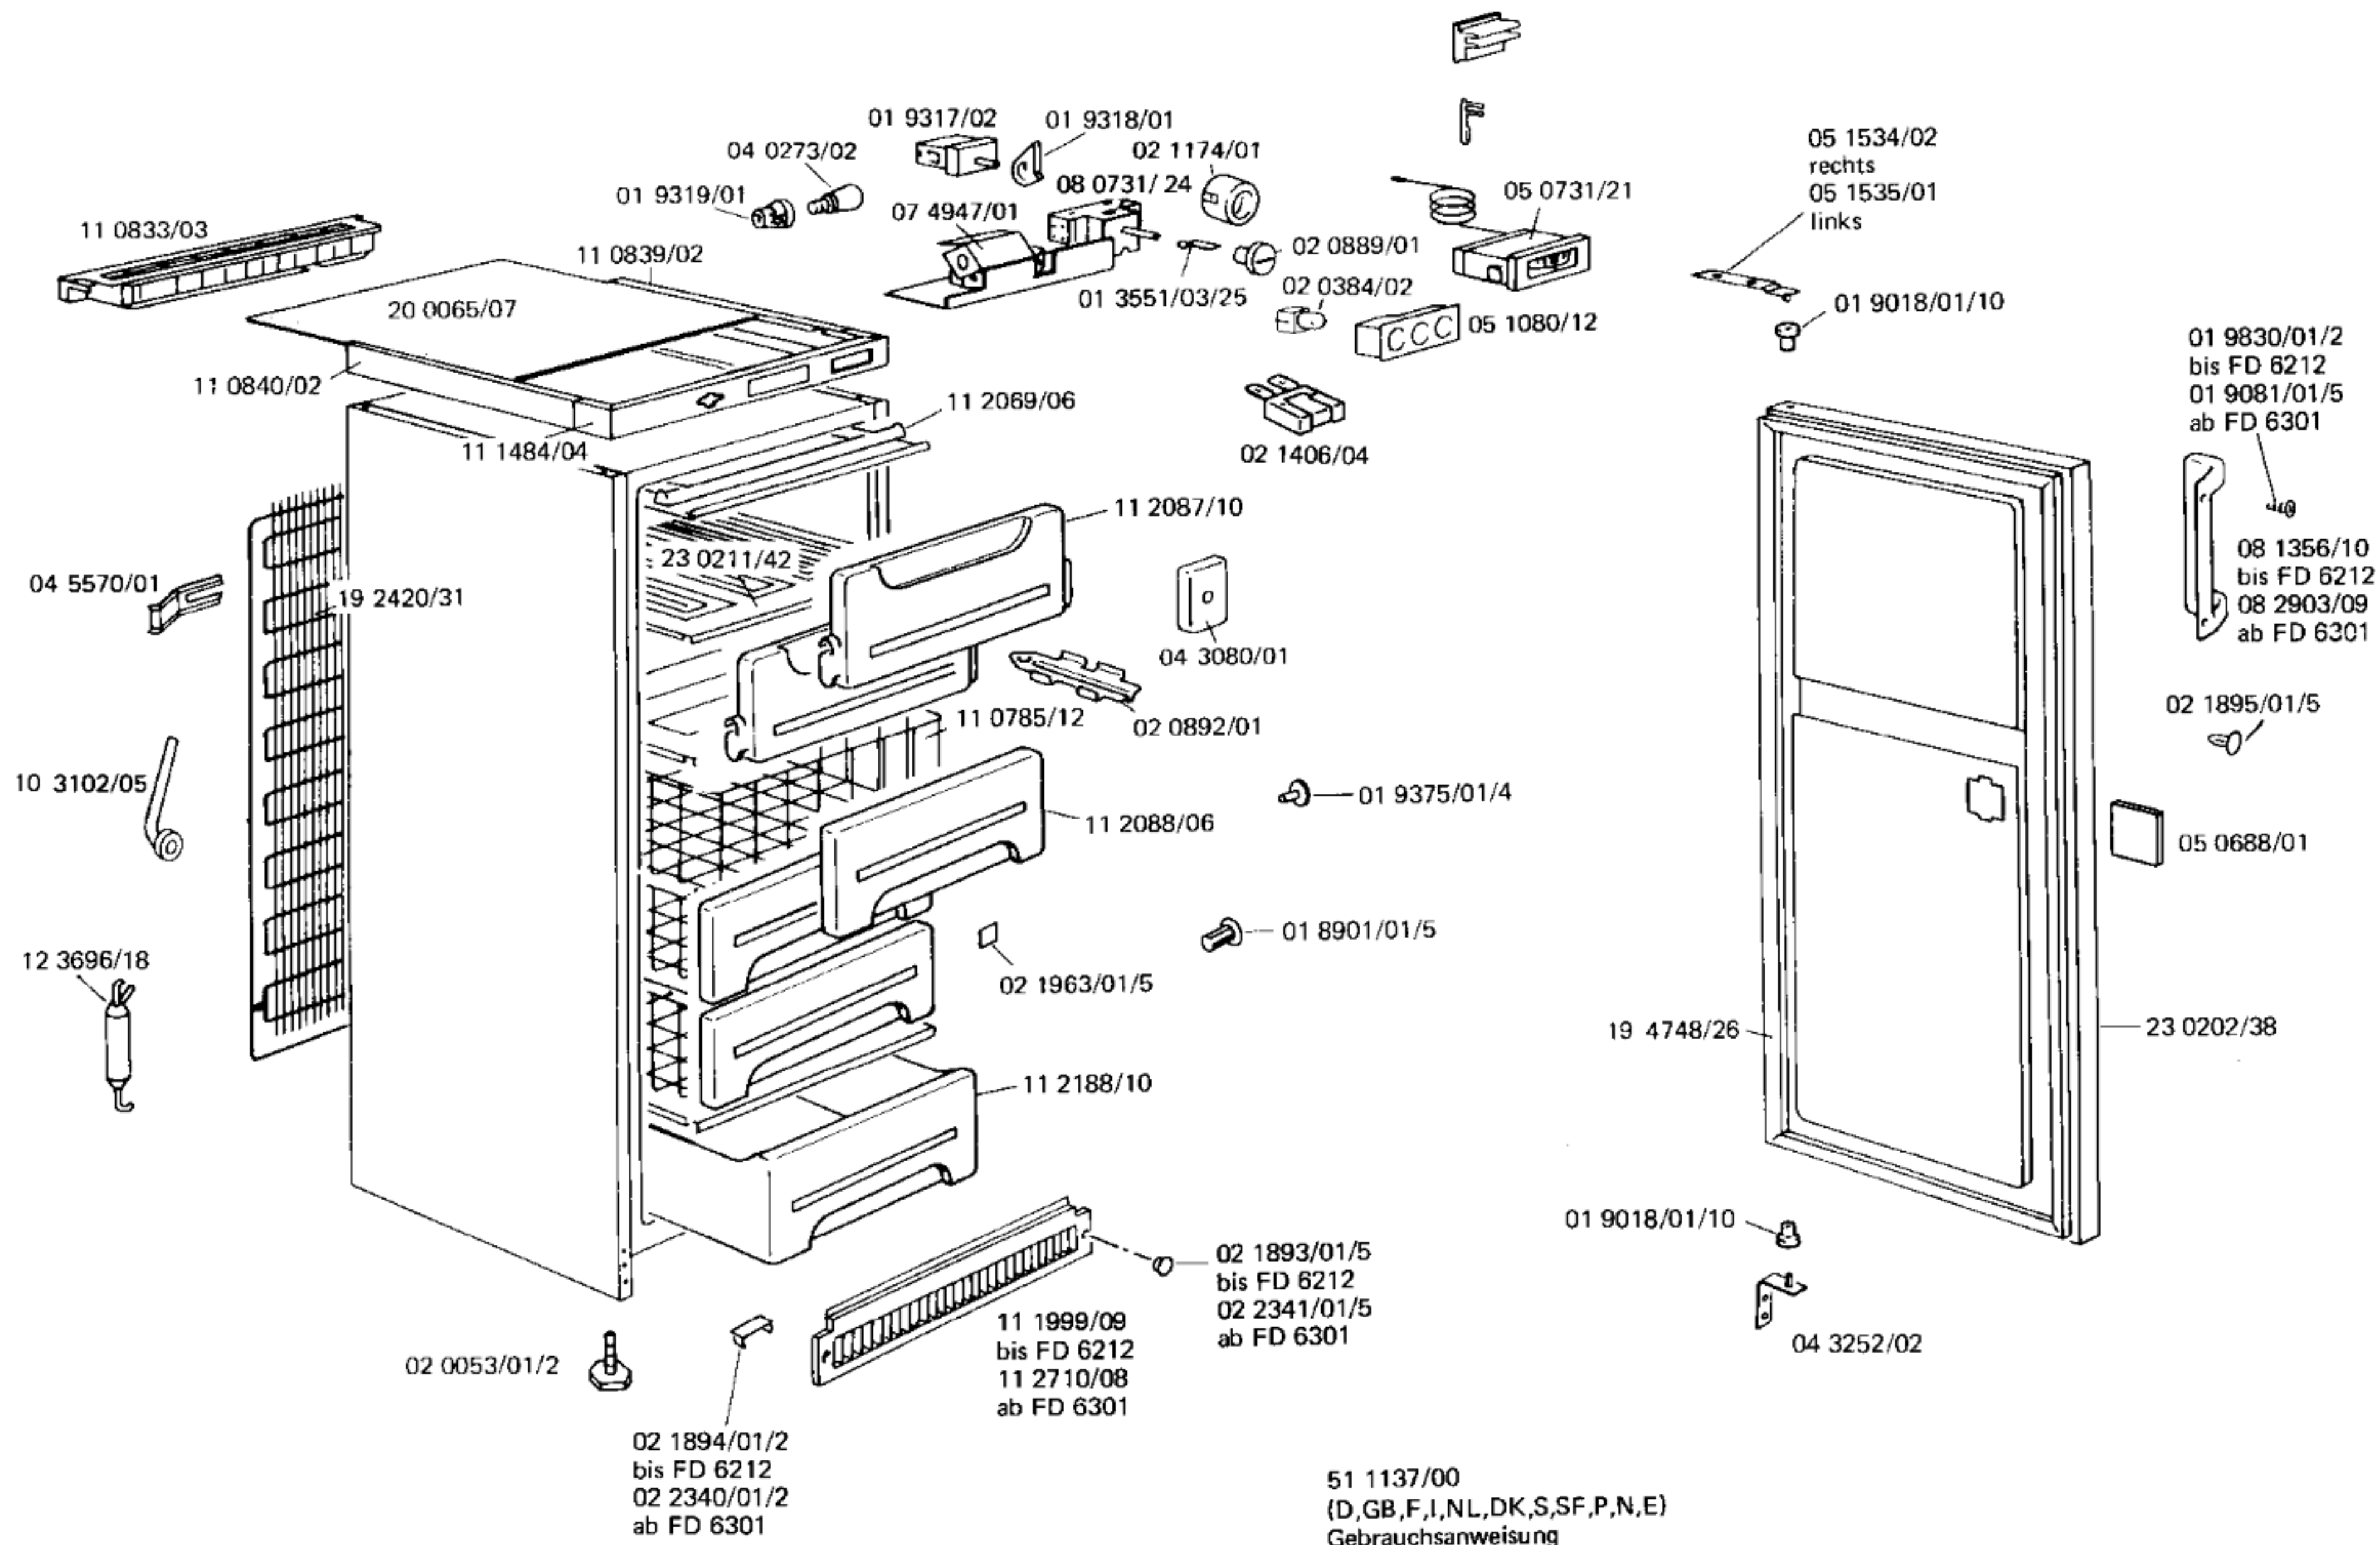

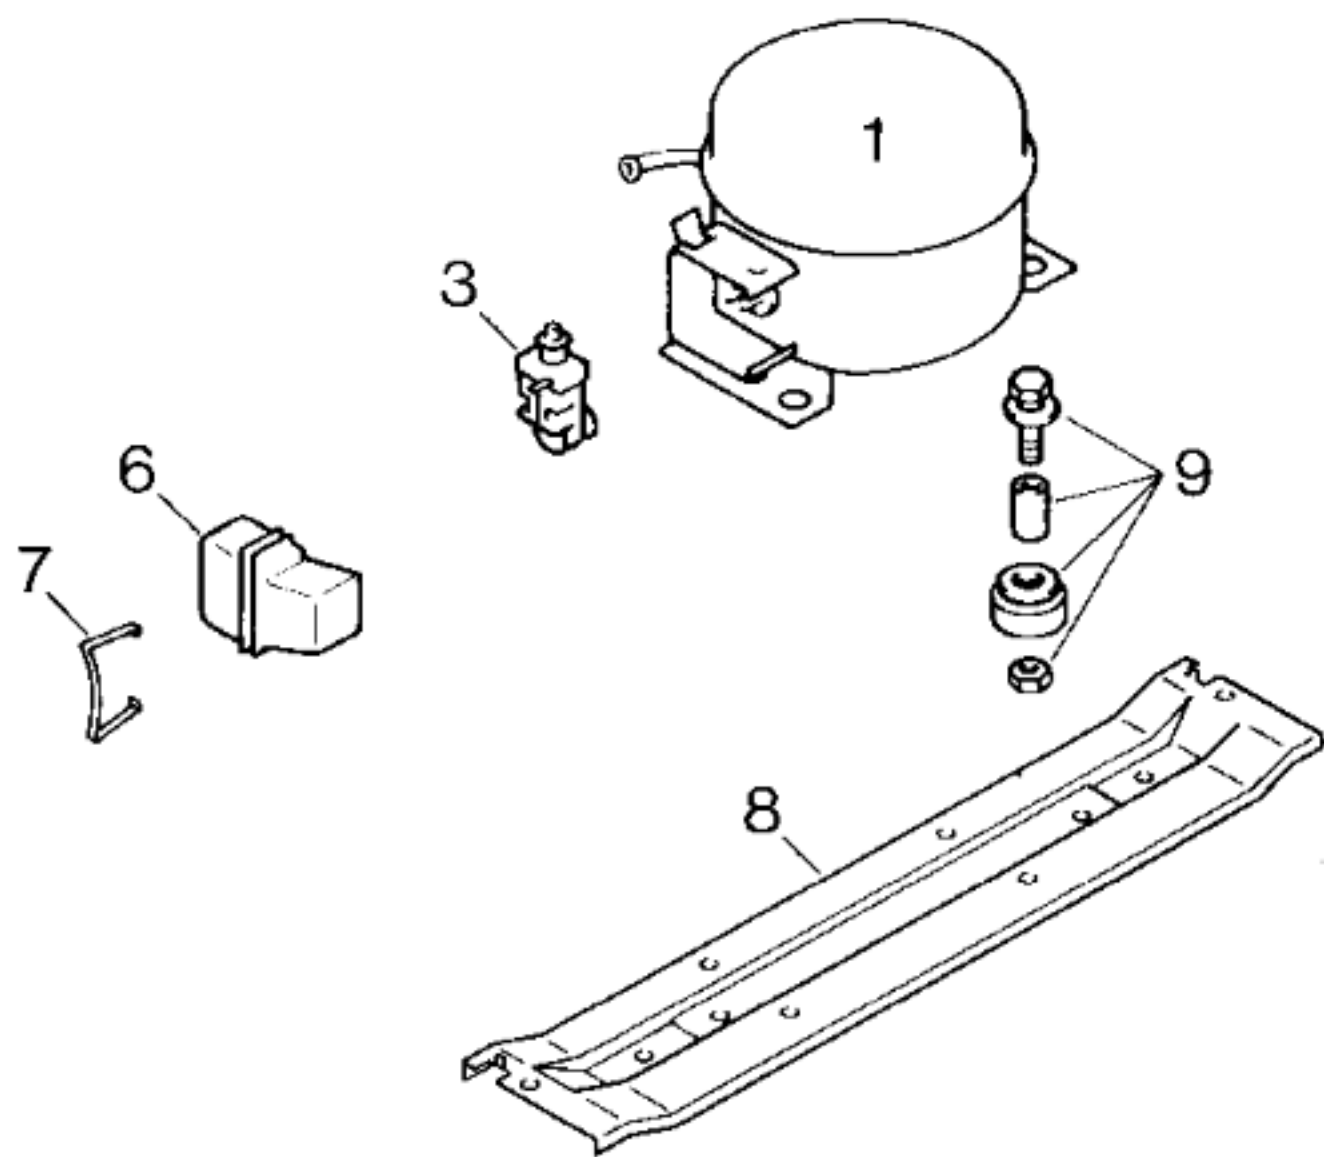

Ausführung	Pos.					
		Danfoss	Matsushita			
Verdichter	1	14 0023/45	14 0107/44			
Schutzschalter	2	—	02 1733/09			
Anlaufrelais	3	02 0108/27	02 1734/09			
Klemmbrett	4	—	05 1289/14			
Zugentlastung	5	—	—			
Kappe	6	05 1413/05	05 1289/14			
Klammer	7	—	02 1735/01/2			
Tragschiene	8	11 1567/03	—			
Befestigung	9	05 0166/05	—			
Kondensator	10	—	—			
Verdunsterschale	11	—	—			
Befestigung	12	—	—			
Winkel	13	—	—			
Kabelsatz	14	—	—			

TECHNISCHE DATEN					
Verdichter	Danfoss	Matsushita			
Typ	FR 7,5 A	FN 73 F 13 S			
Förderleistung	l/h	V 1250	V 1310		
Anlaufstrom	A	9,6	8,0		
Widerstand	Ω Ha	14,5	11,6		
	Hi	14,2	60,6		
Temp.-Regler:	Ranco				
Typ	A 56				
Reglerstellung	kalt	warm			
Schaltwerte °C ein:	- 26	- 18			
aus:	- 34	- 24			
(abtauen od.) alarm:	- 20	- 13			
Füllmenge R 12 g	175				
Anschlußwert W	150				
Heizung:					
Widerstand	Ω				
Leistung	W				
Ventilator:					
Widerstand	Ω				
Magnetventil:					
Widerstand	Ω				
Spannung	V				