


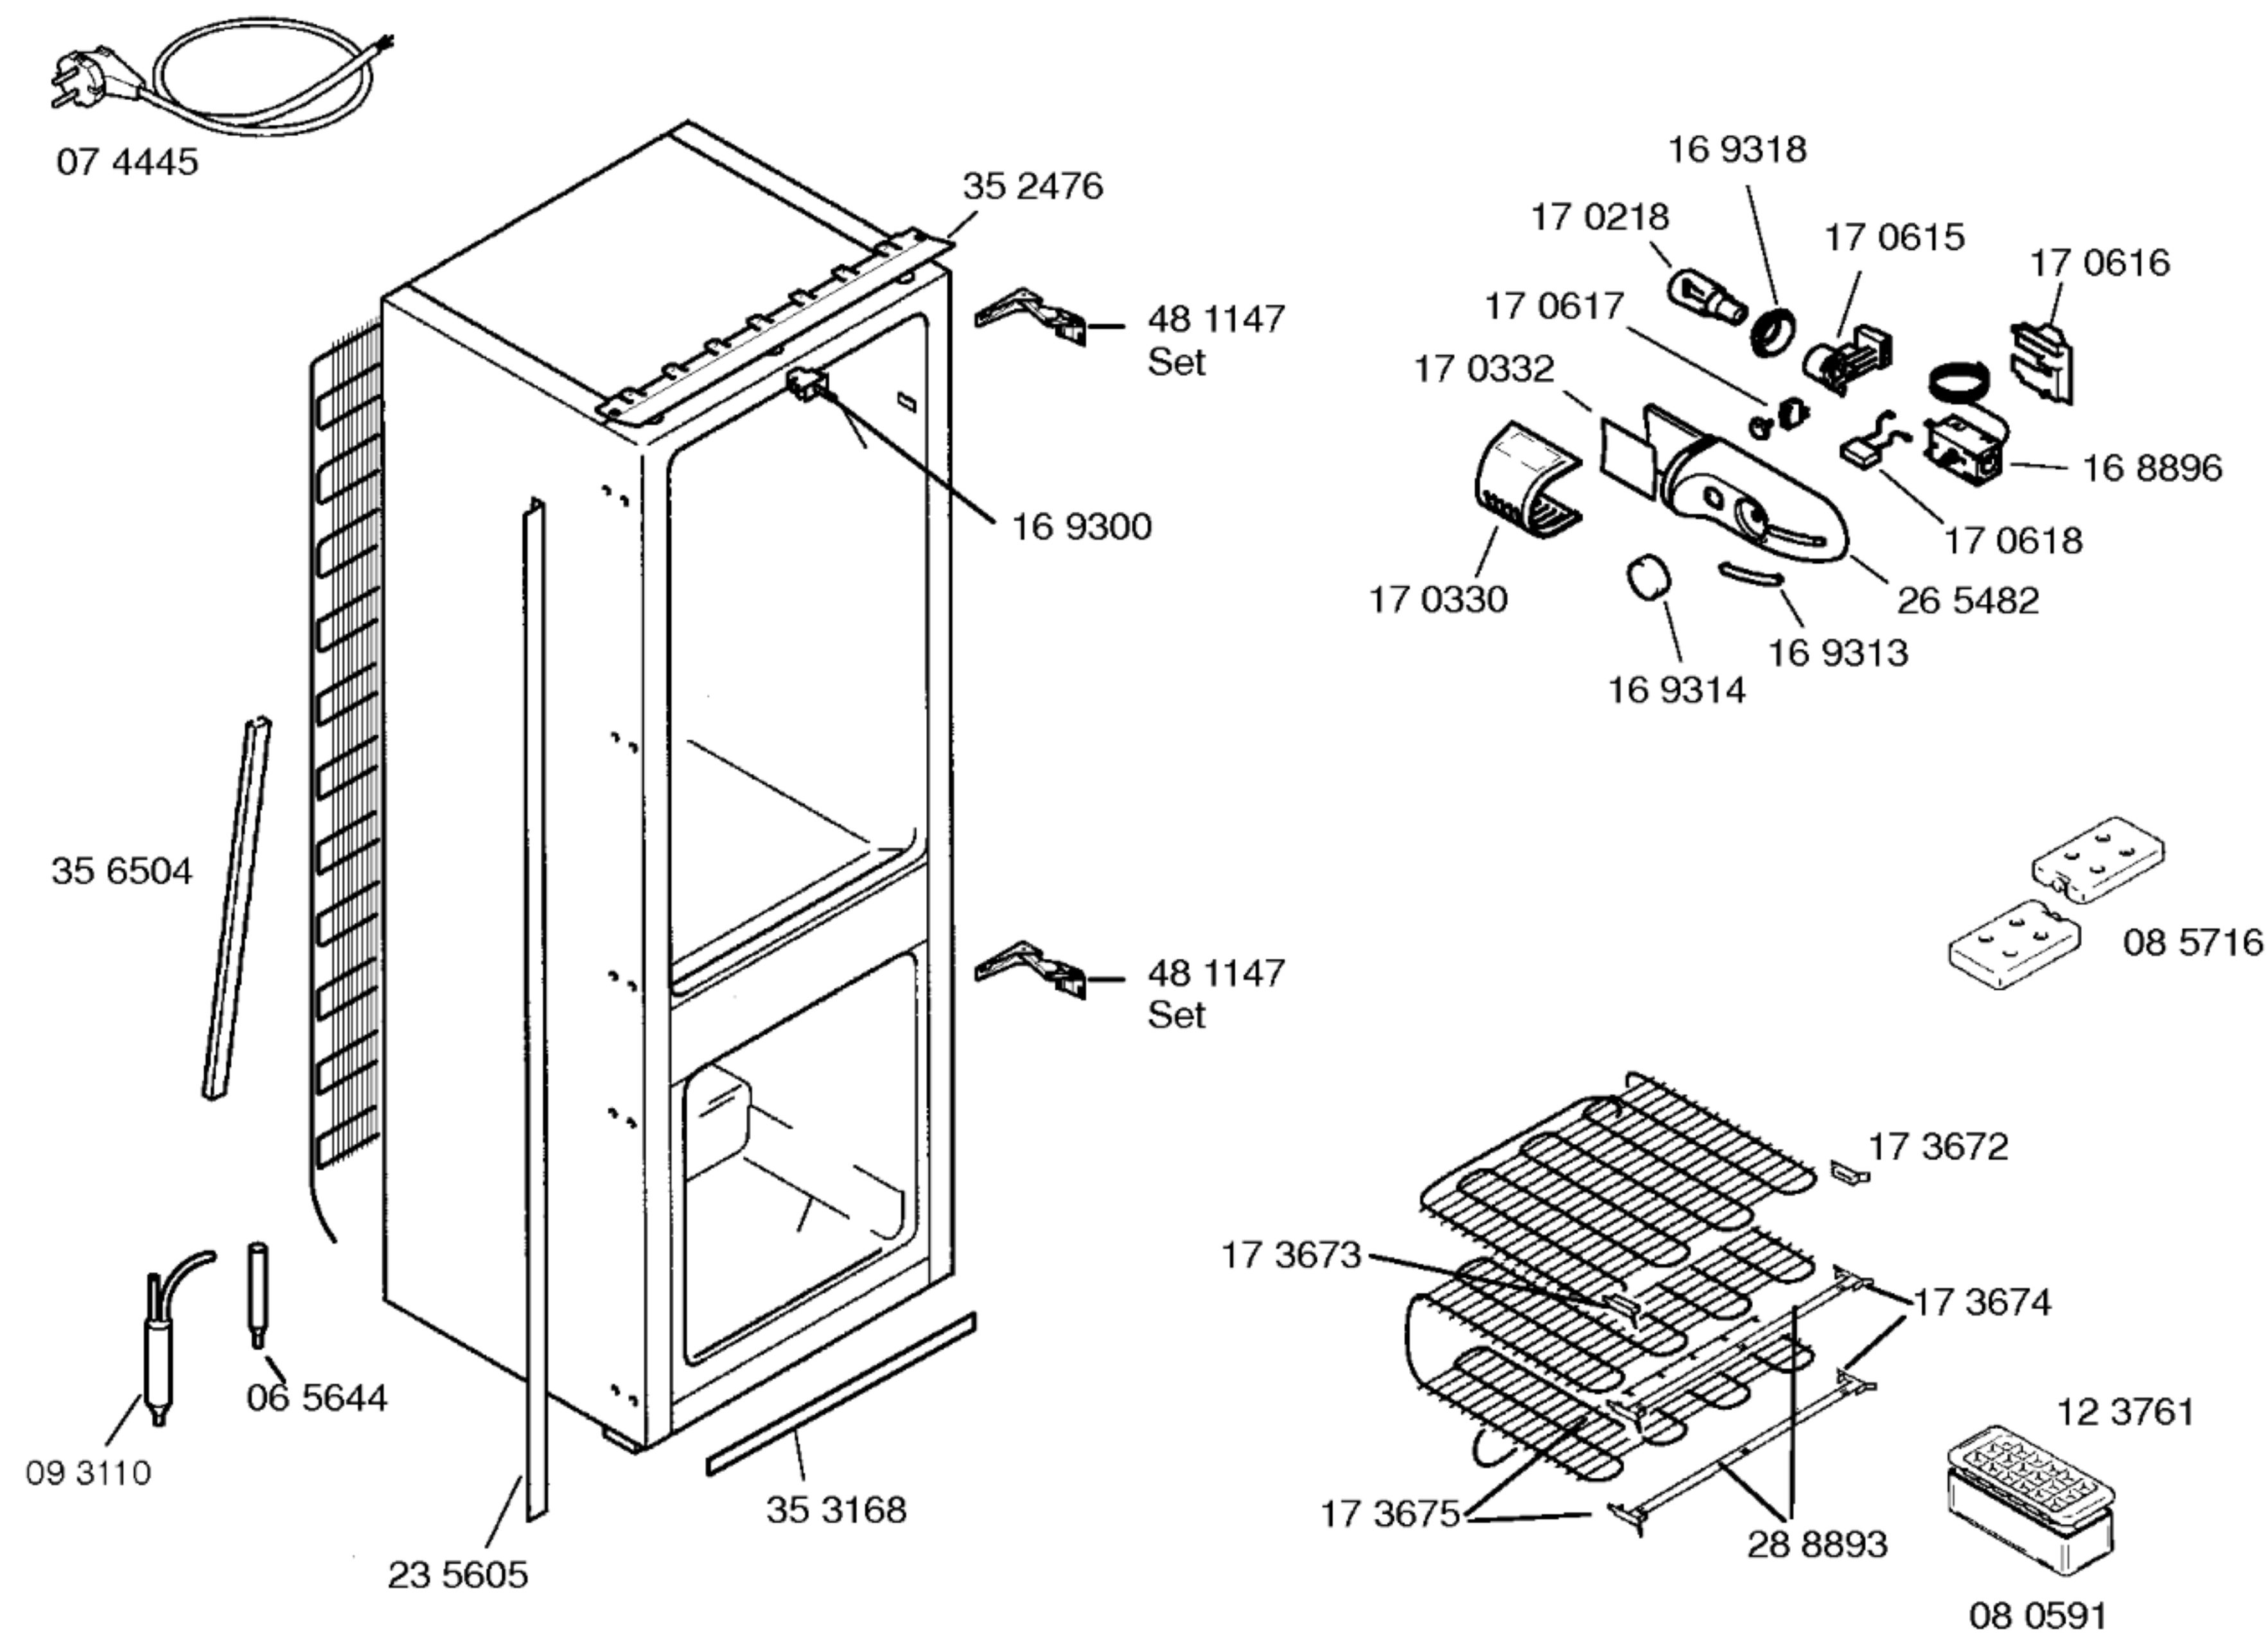








Mat. - Nr. - Konstante
3740

Gebrauchsanweisung
52 4294

(D,GB,F,I,NL,S,E,DK,N,,SF)

Montageanleitung
52 2494
(D,GB,F,I,NL,S,E,DK,N,,SF)


Befestigungssatz
26 6910

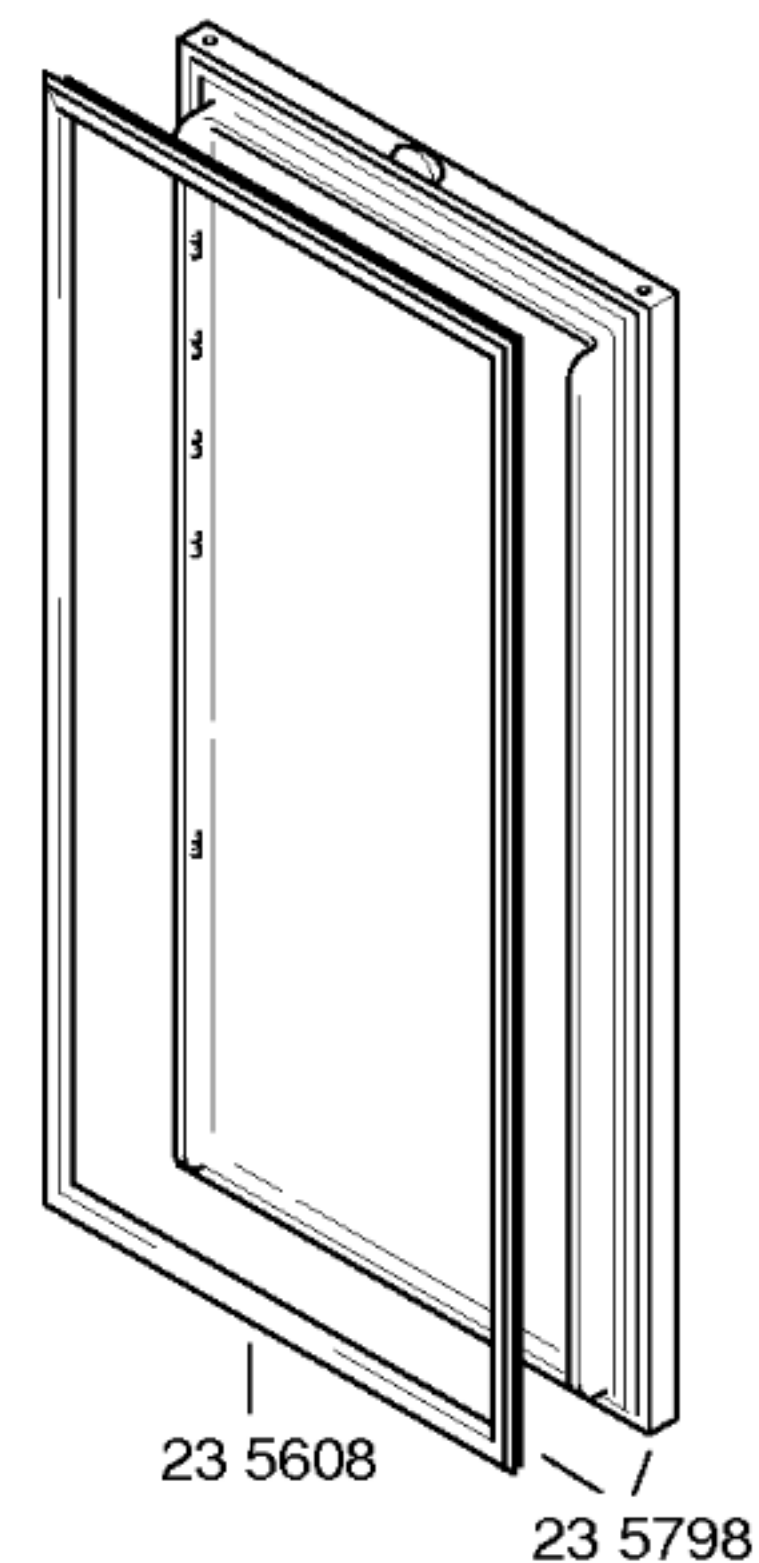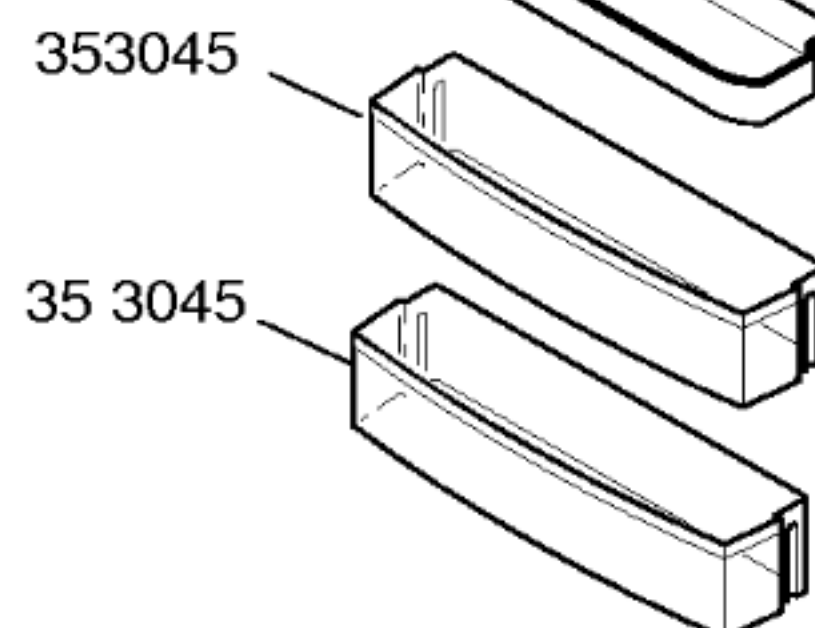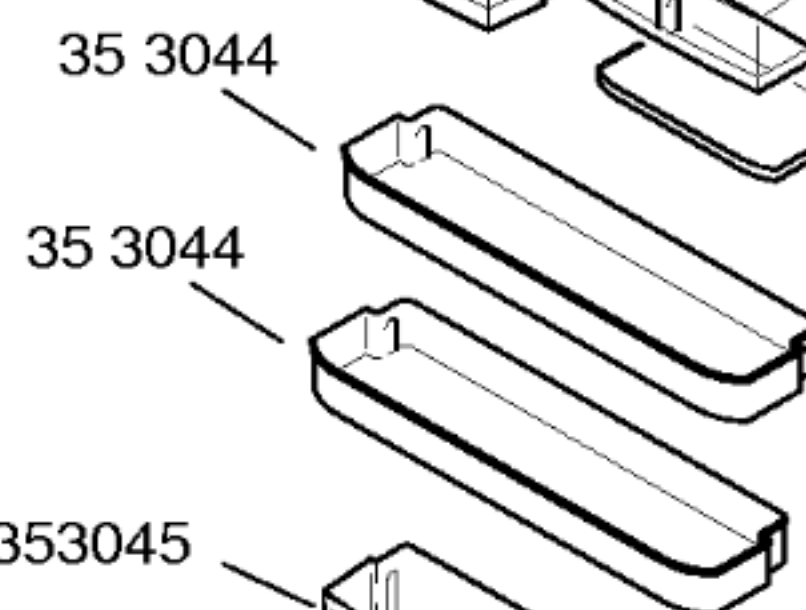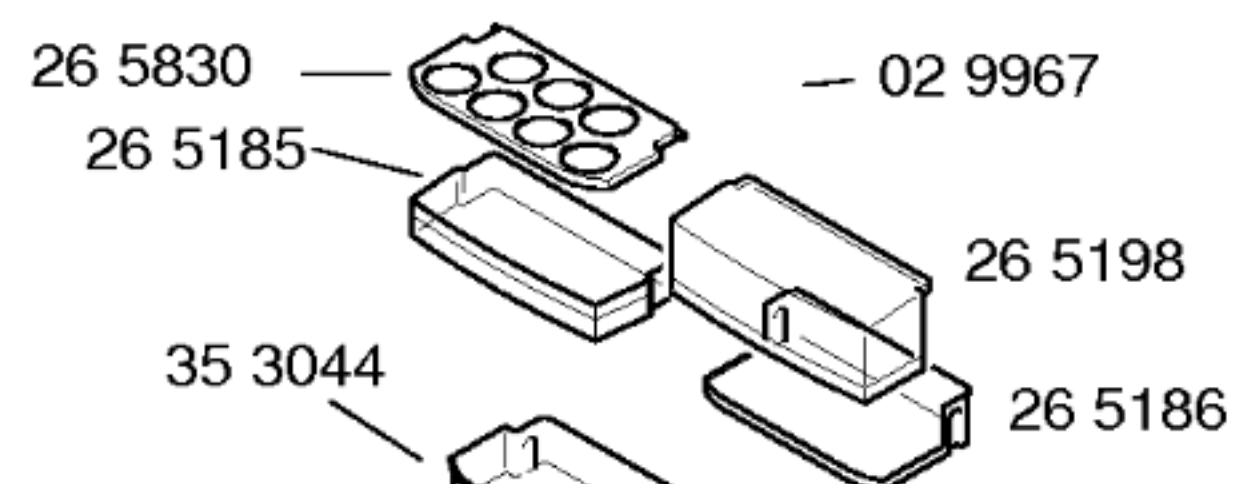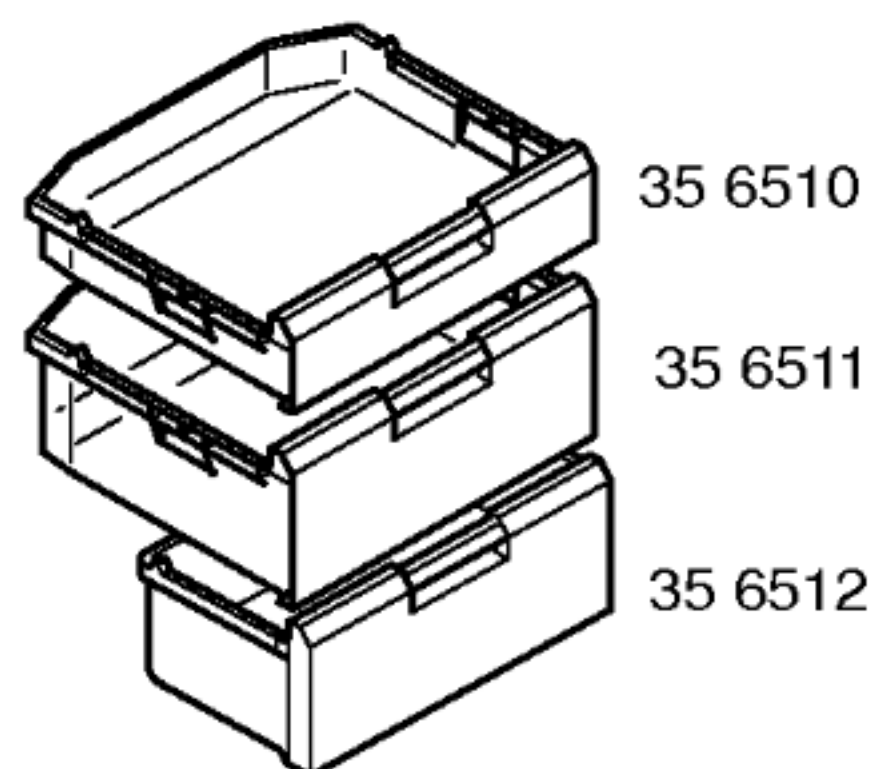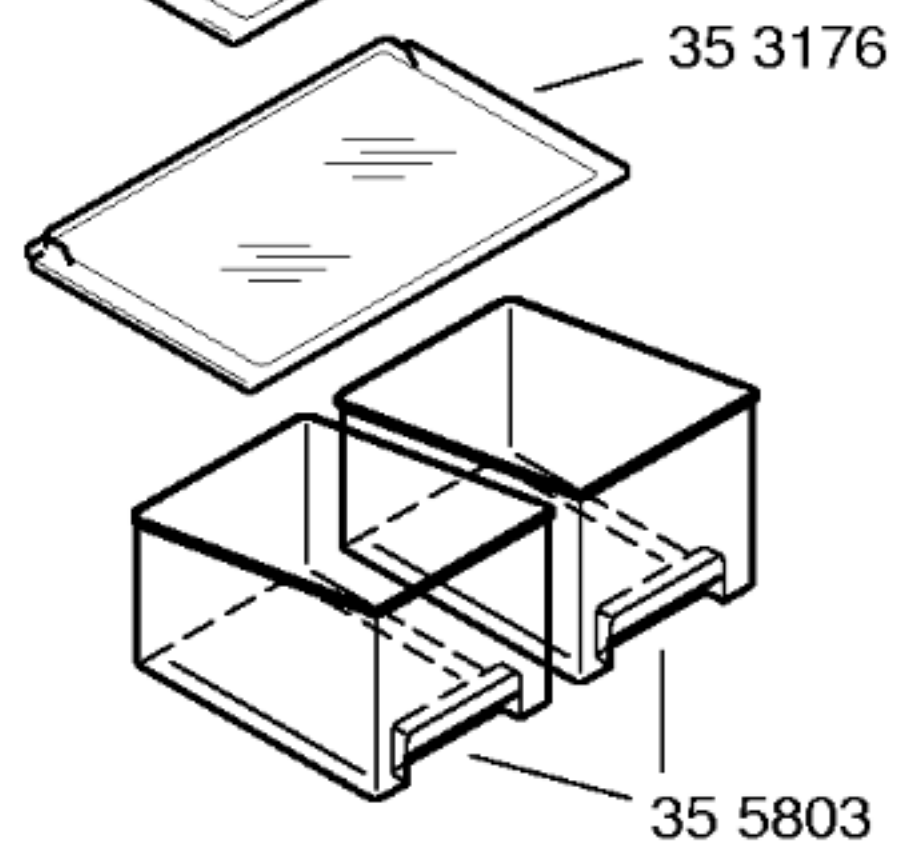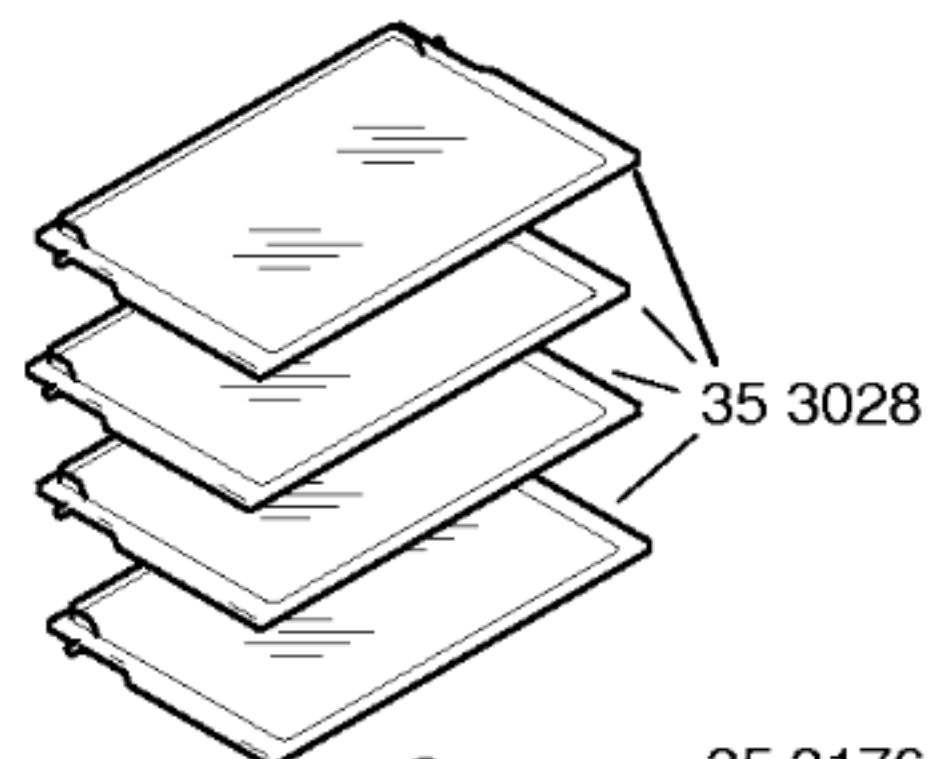


21 5533

21 5217

05 6874

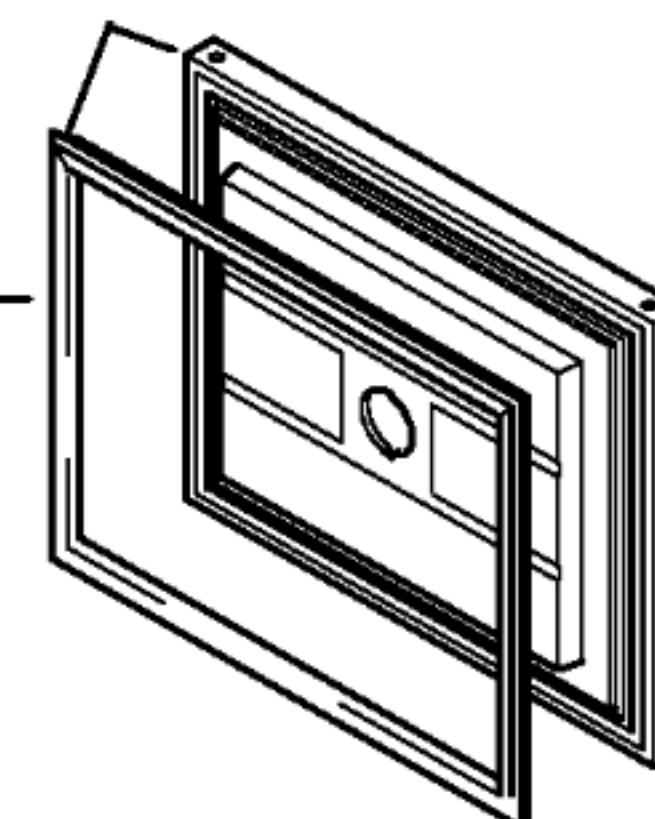

Mat. – Nr. – Konstante
3740

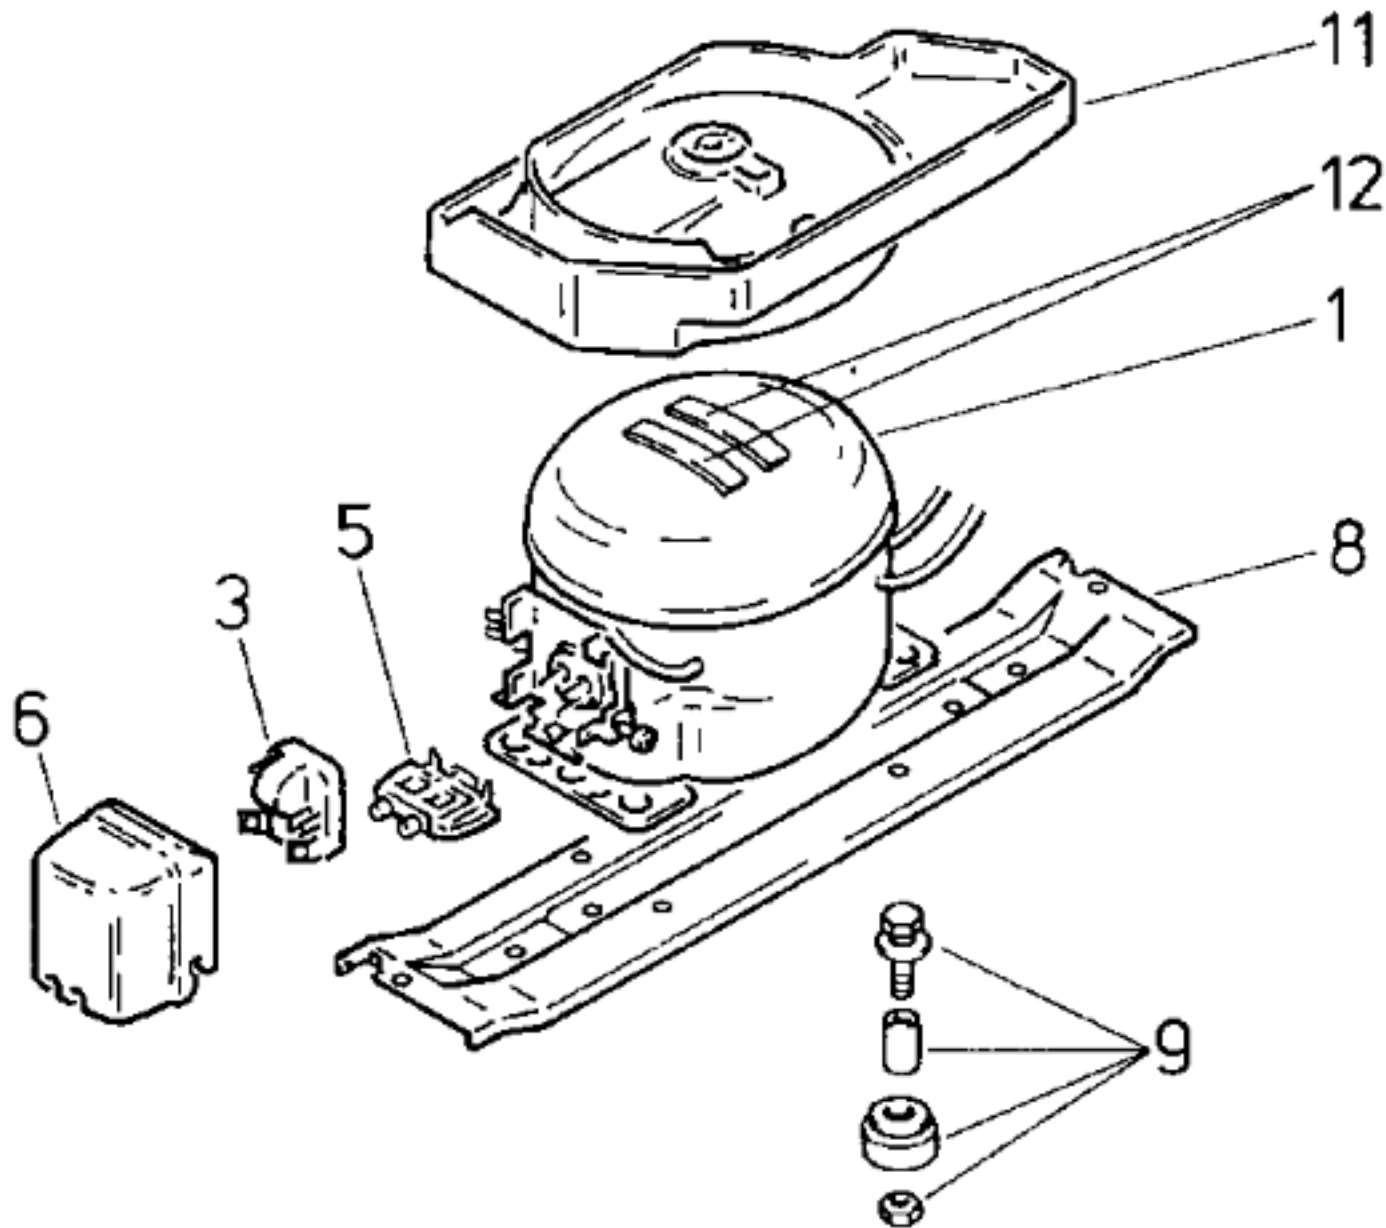

Pos.	V01	V02	
	Danfoss	Matsushita	
	NLY 13K	DC125 E	
1	14 1747	141965	
2			
3	15 1055	17 2967	
4			
5	15 1053	16 2549	
6	15 1072	16 6782	
7			
8	28 1825	28 1825	
9	05 0166	05 0166	
10	05 9467		
11	26 6624	26 6624	
12	05 6008	05 6008	

TECHNISCHE DATEN / TECHNICAL DATA / DONNEES TECHNIQUES				
Verdichter/Compressor/Compresseur		Danfoss	Matsushita	
Typ/Type		NLY 13 K	DC125E	
Förderleistung/Delivery/Débit		l/h	2246	
Anlaufstrom/Starting current/Cour. de démarrage		A	9,2	
Widerstand/Resistance/Résistance		Ha/main/prin. Ω	12,1	
		Hi/aux Ω	13,8	
Temp.-Regler/Thermostat		RCO K59		
Typ/Type		KER		
Reglerstellung/Position		kalt	warm	
Schaltwerte/Switching values/		„ein“ $^{\circ}\text{C}$	+4,5	
Valeurs de commutation		„aus“	+4,5	
		(„abtauen“ od.) „alarm“	-32,0	
Füllmenge/Fill.quantity/Charge		R600a	g	*
Anschlußwert/Conn.foad/Puiss. connectée		W	150	120
Heizung/Heater/Chauffage				
Widerstand/Resistance/Résistance		Ω		
Leistung/Power/Puissance		W		
Ventilator/Blower/Ventilateur				
Widerstand/Resistance/Résistance		Ω		
Magnetventil/Magnetic valve/Electrovanne				
Widerstand/Resistance/Résistance		Ω		
Spannung/Voltage/Tension		V		

* siehe Typenschild